


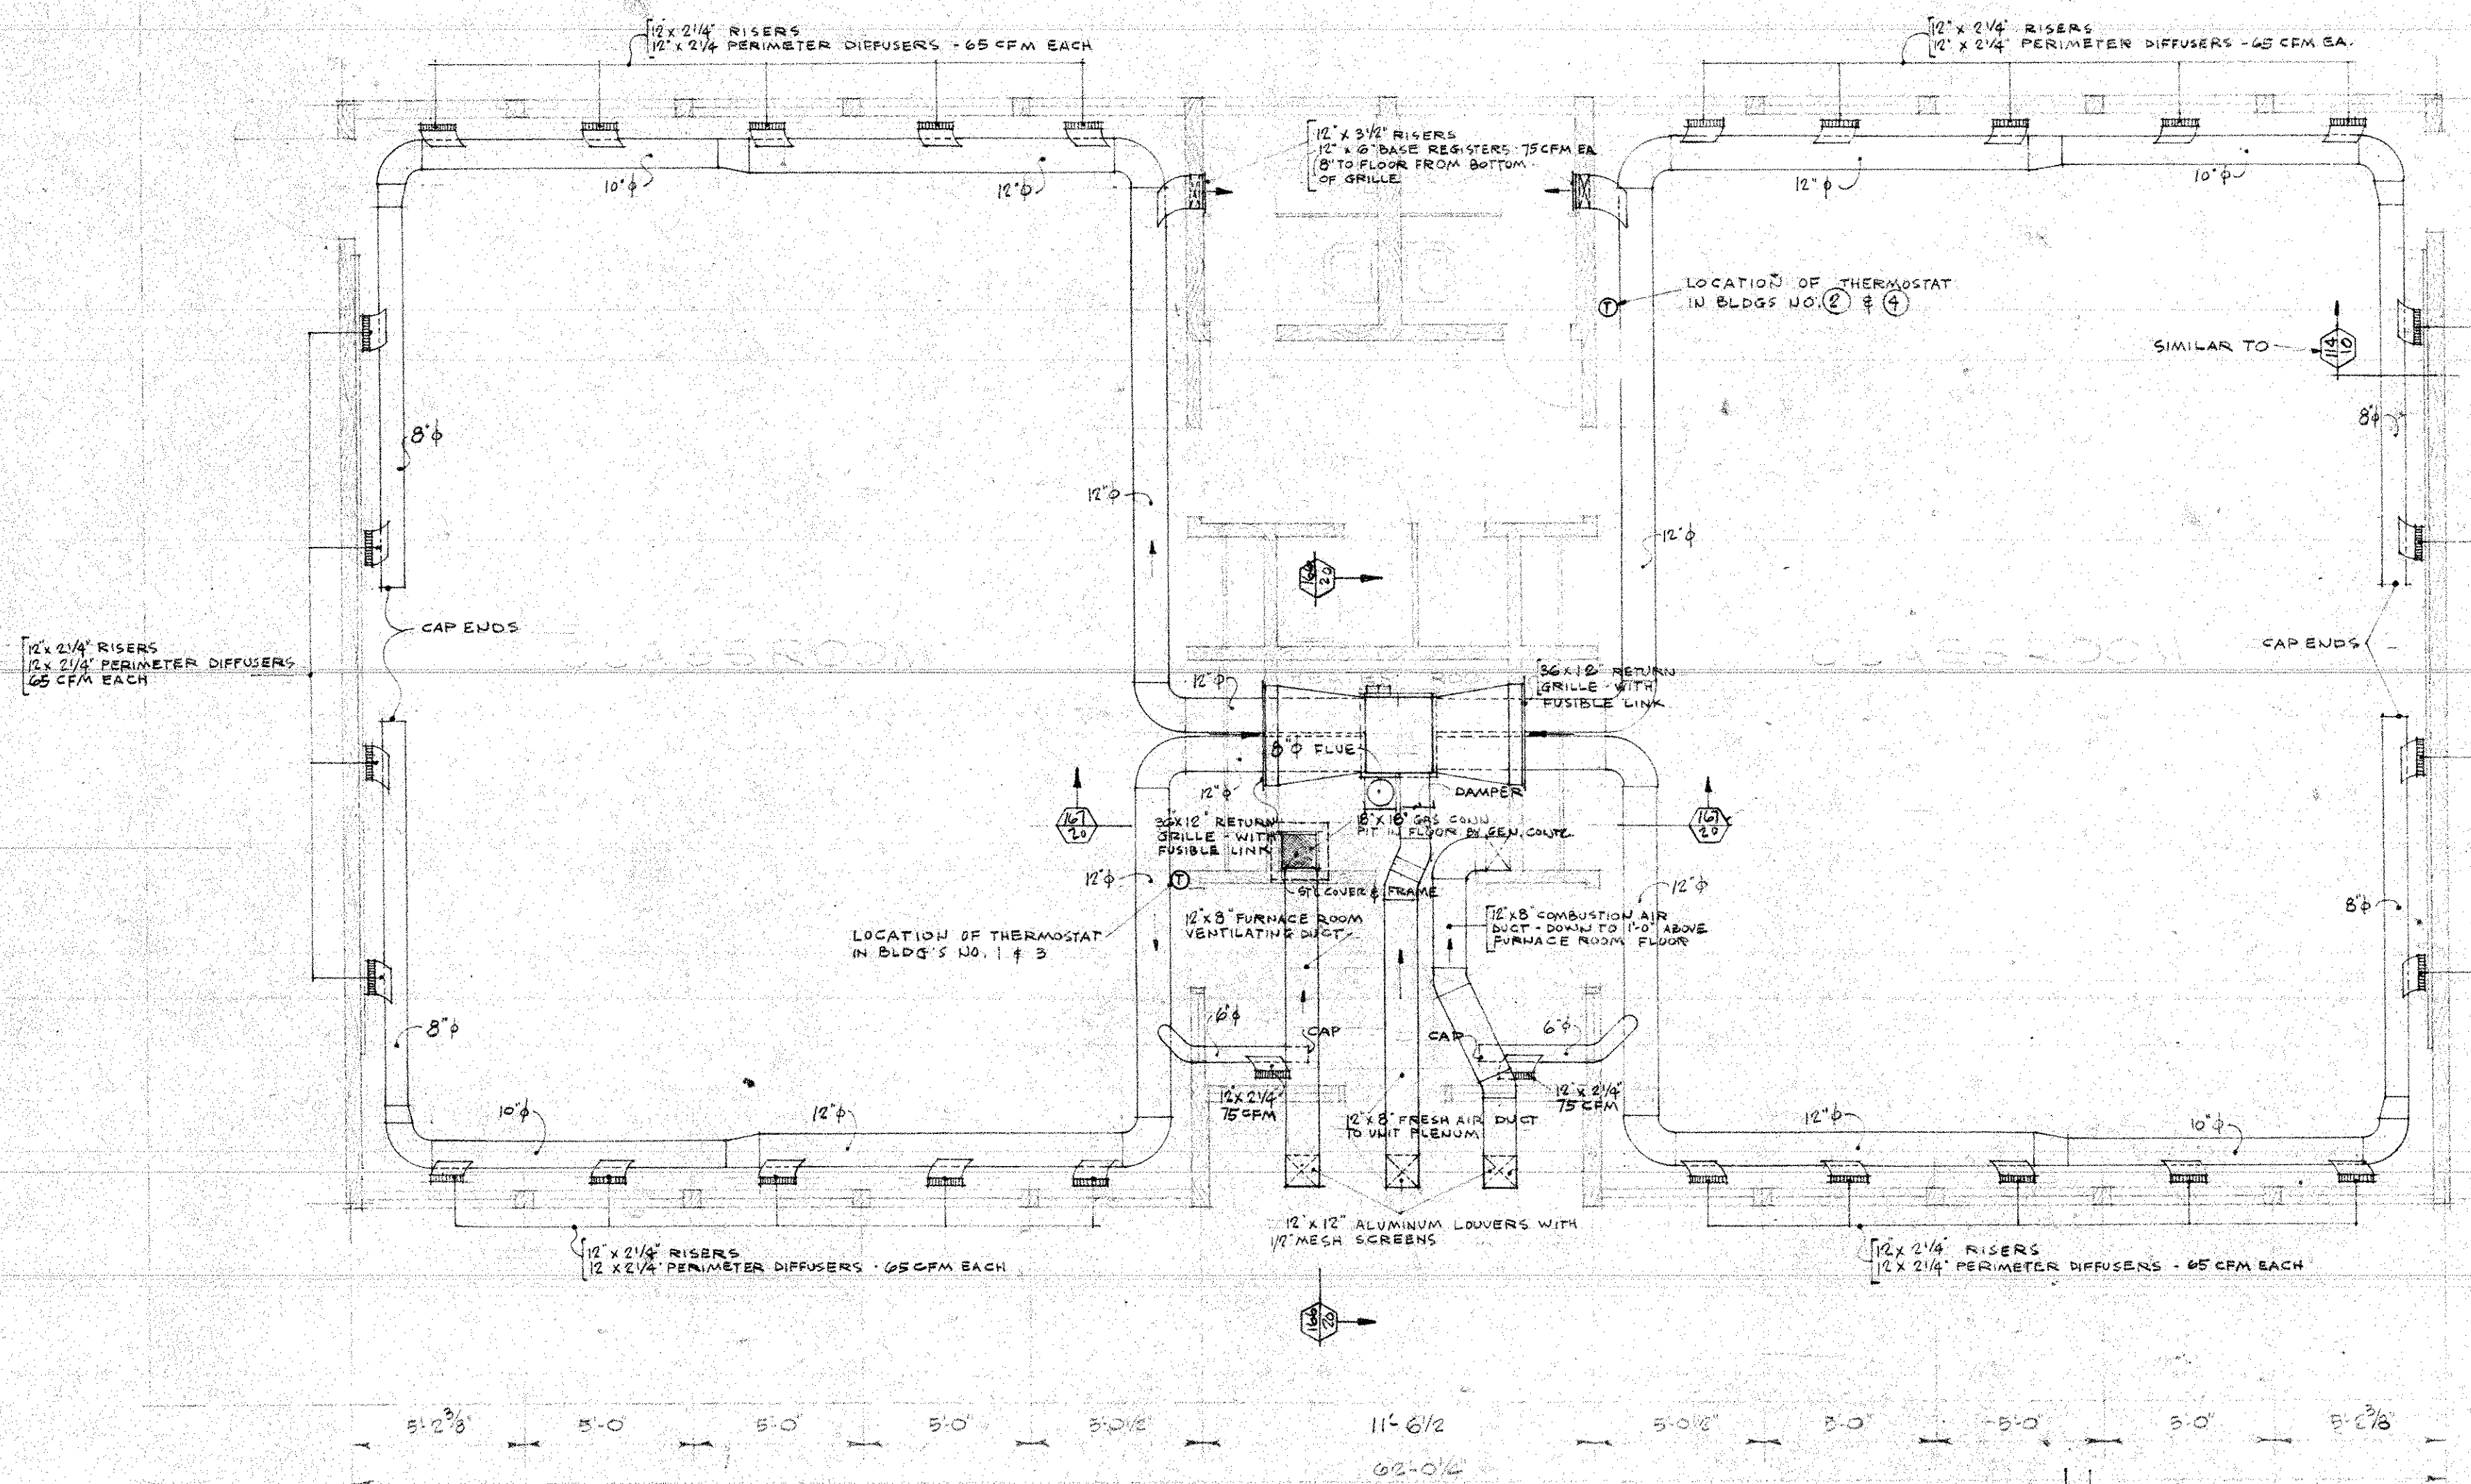

GENERAL NOTES


REGISTERS & GRILLES:

1. ALL PERIMETER DIFFUSERS SHALL BE STANDARD STAMPING & PERFORATING CO. SERIES PH SIZED AS SHOWN ON THE PLANS.
2. BASE REGISTERS: STANDARD STAMPING AND PERFORATING CO. #41H
3. RETURN GRILLES: TUTTLE & BAILEY CO. #T-75 WITH SPRING LOADED FUSIBLE LINK DAMPER.
4. HEATER ROOM SHOWN IS TYPICAL FOR BUILDINGS #1 THRU #6
5. DUCTWORK SHOWN IS TYPICAL FOR BUILDINGS #1 THRU #6 EXCEPT FOR LOCATION AND SIZES OF PERIMETER DIFFUSERS WHICH VARY. SEE RETURN AIR SYSTEM FOR BLDG #6 WHICH IS

GENERAL:


1. HEATER ROOM SHOWN IS TYPICAL FOR BUILDINGS #1 THRU #6
2. DUCTWORK SHOWN IS TYPICAL FOR BUILDINGS #1 THRU #6 EXCEPT FOR LOCATION AND SIZES OF PERIMETER DIFFUSERS WHICH VARY. SEE RETURN AIR SYSTEM FOR BLDG #6 WHICH IS

HEATING SYMBOLS	
	SUPPLY RISERS
	RETURN RISERS
	SUPPLY WALL REGISTER
	RETURN WALL GRILLE
	VOLUME DAMPER WITH QUADRANT LOCK
	SPLITTER DAMPER WITH QUADRANT LOCK
	WALL THERMOSTAT
	THERMOMETER
	RELIEF VALVE
	FLEXIBLE DUCT CONNECTION
	GATE VALVE
	GLOBE VALVE
	CHECK VALVE
	UNION
	GAS LINE
	FLOOR OR COUNTER SUPPLY REGISTER
	BASE REGISTER
	GENERAL CONTRACTOR
	MOTORIZED DAMPER

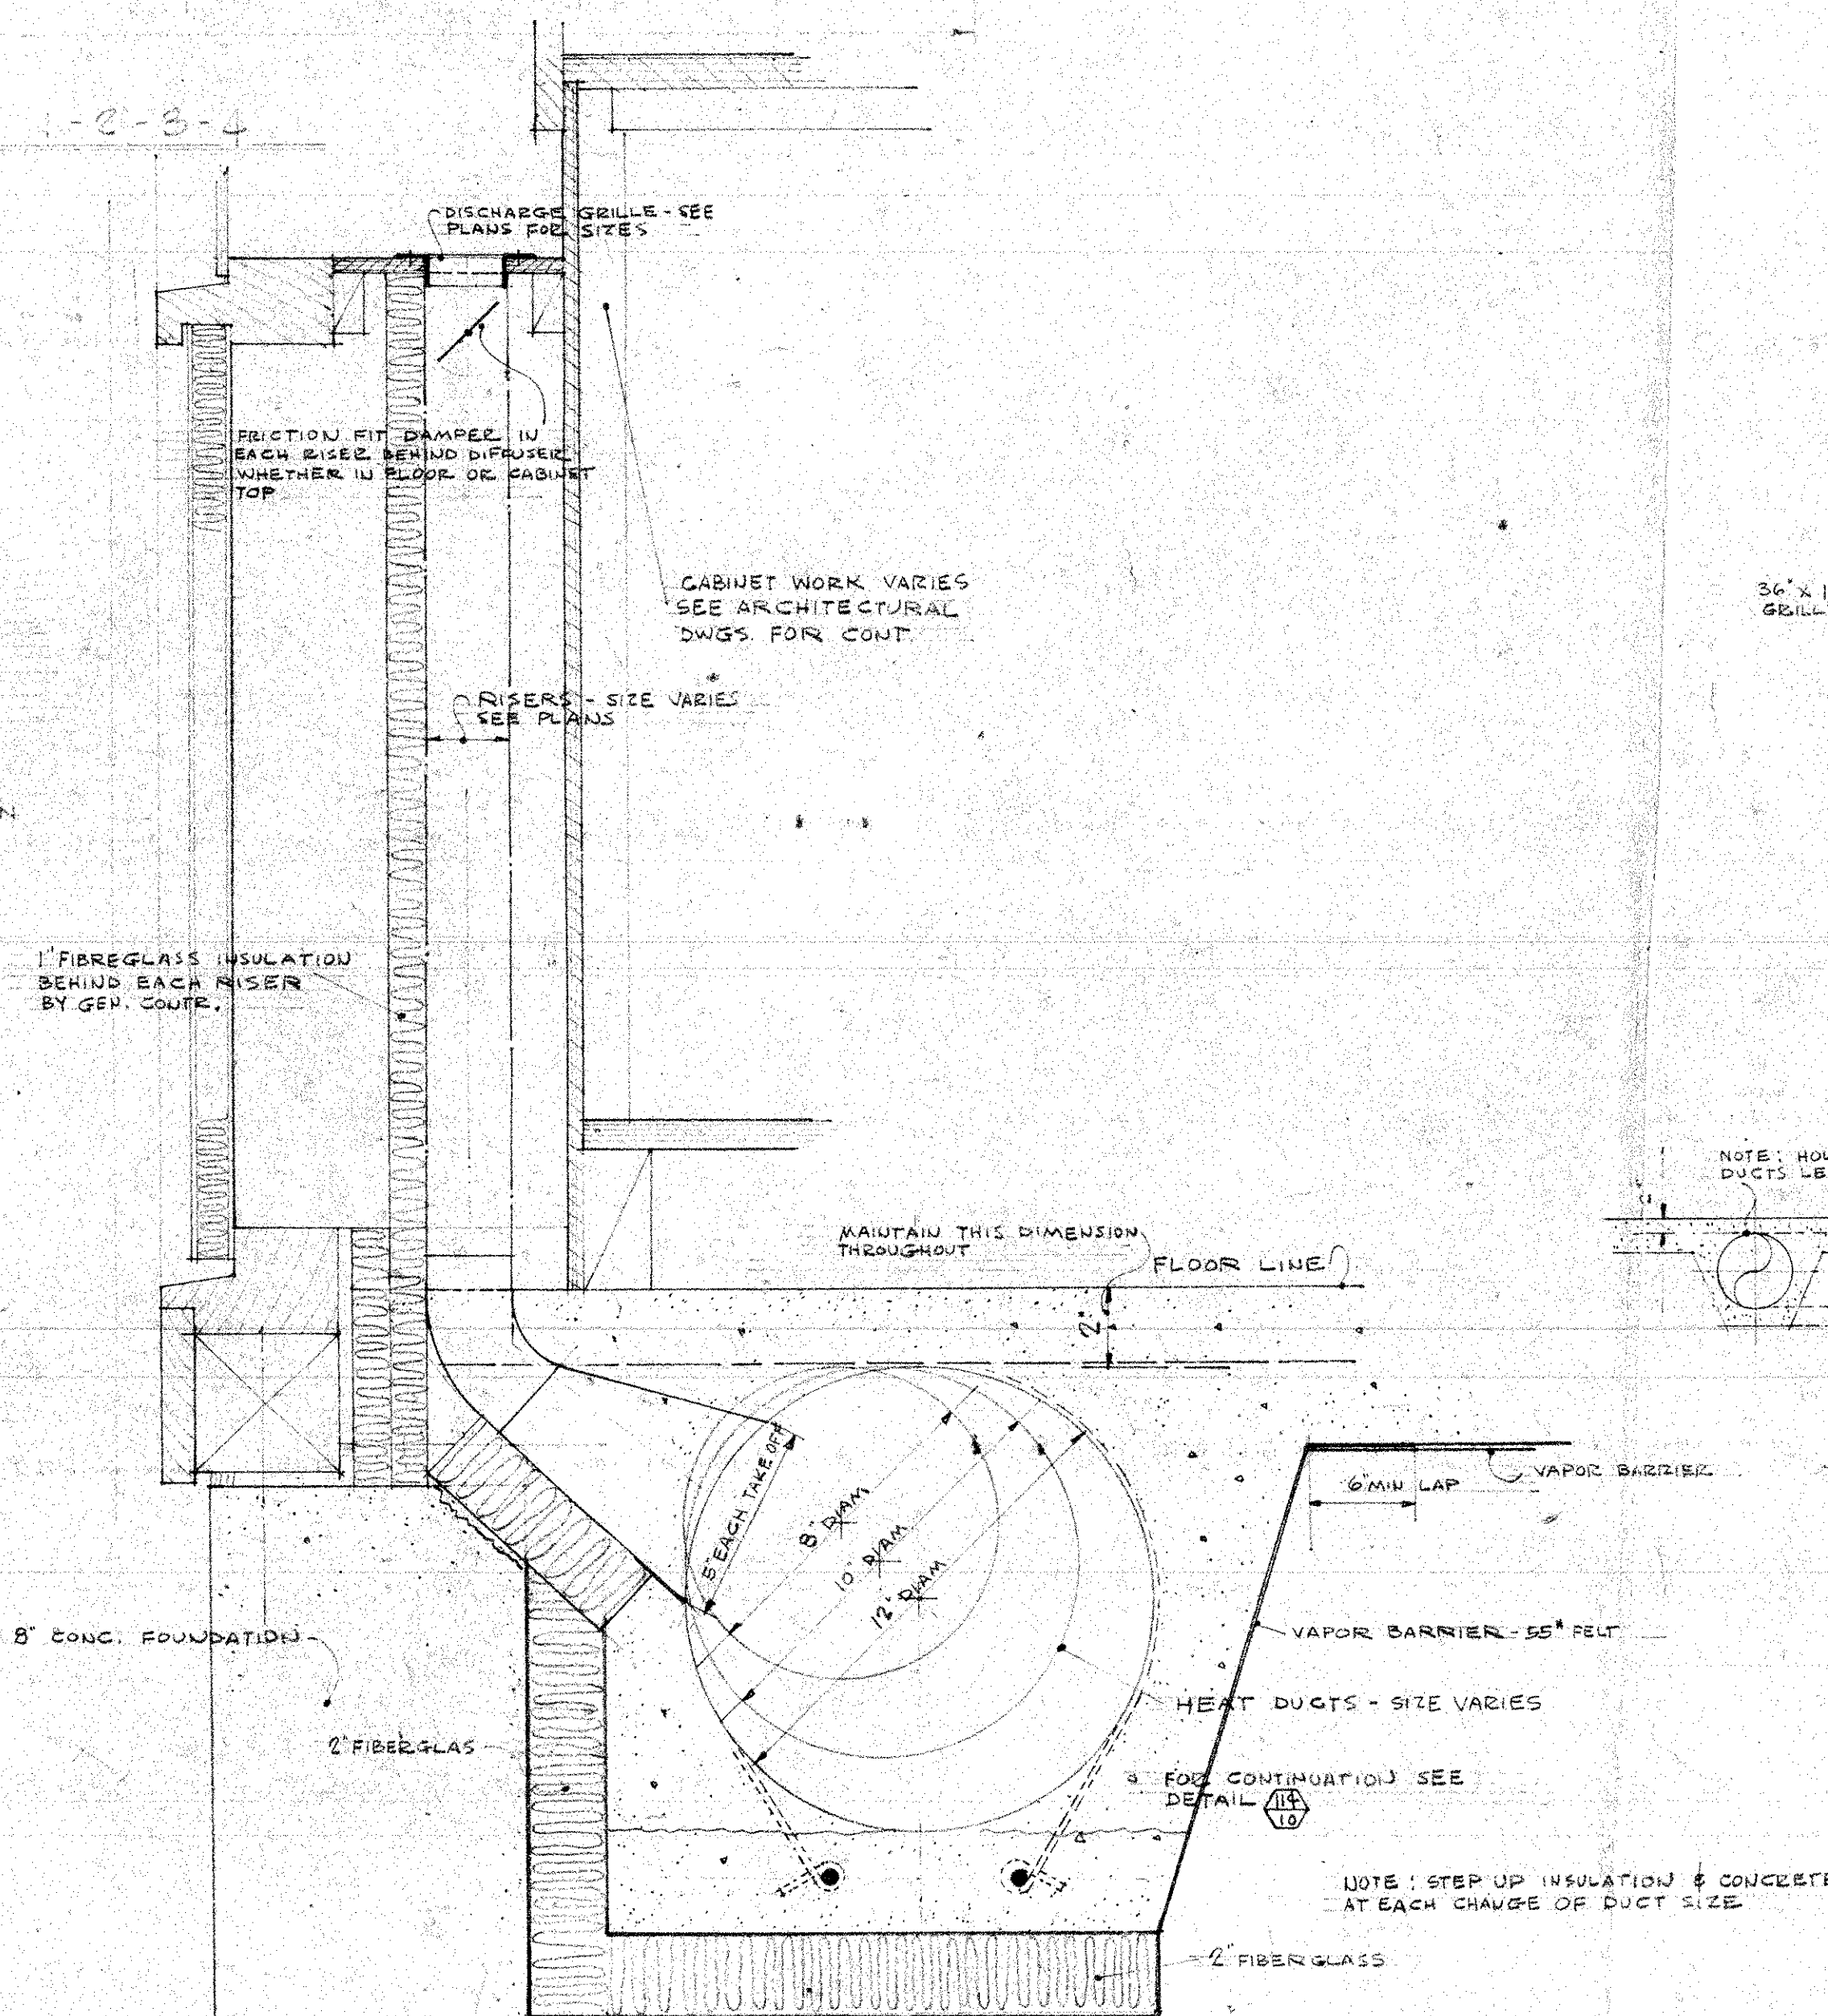


TYPICAL SECTION OF SUPPLY FEEDER AT OUTSIDE WALL

SCALE: 3" = 1'-0"

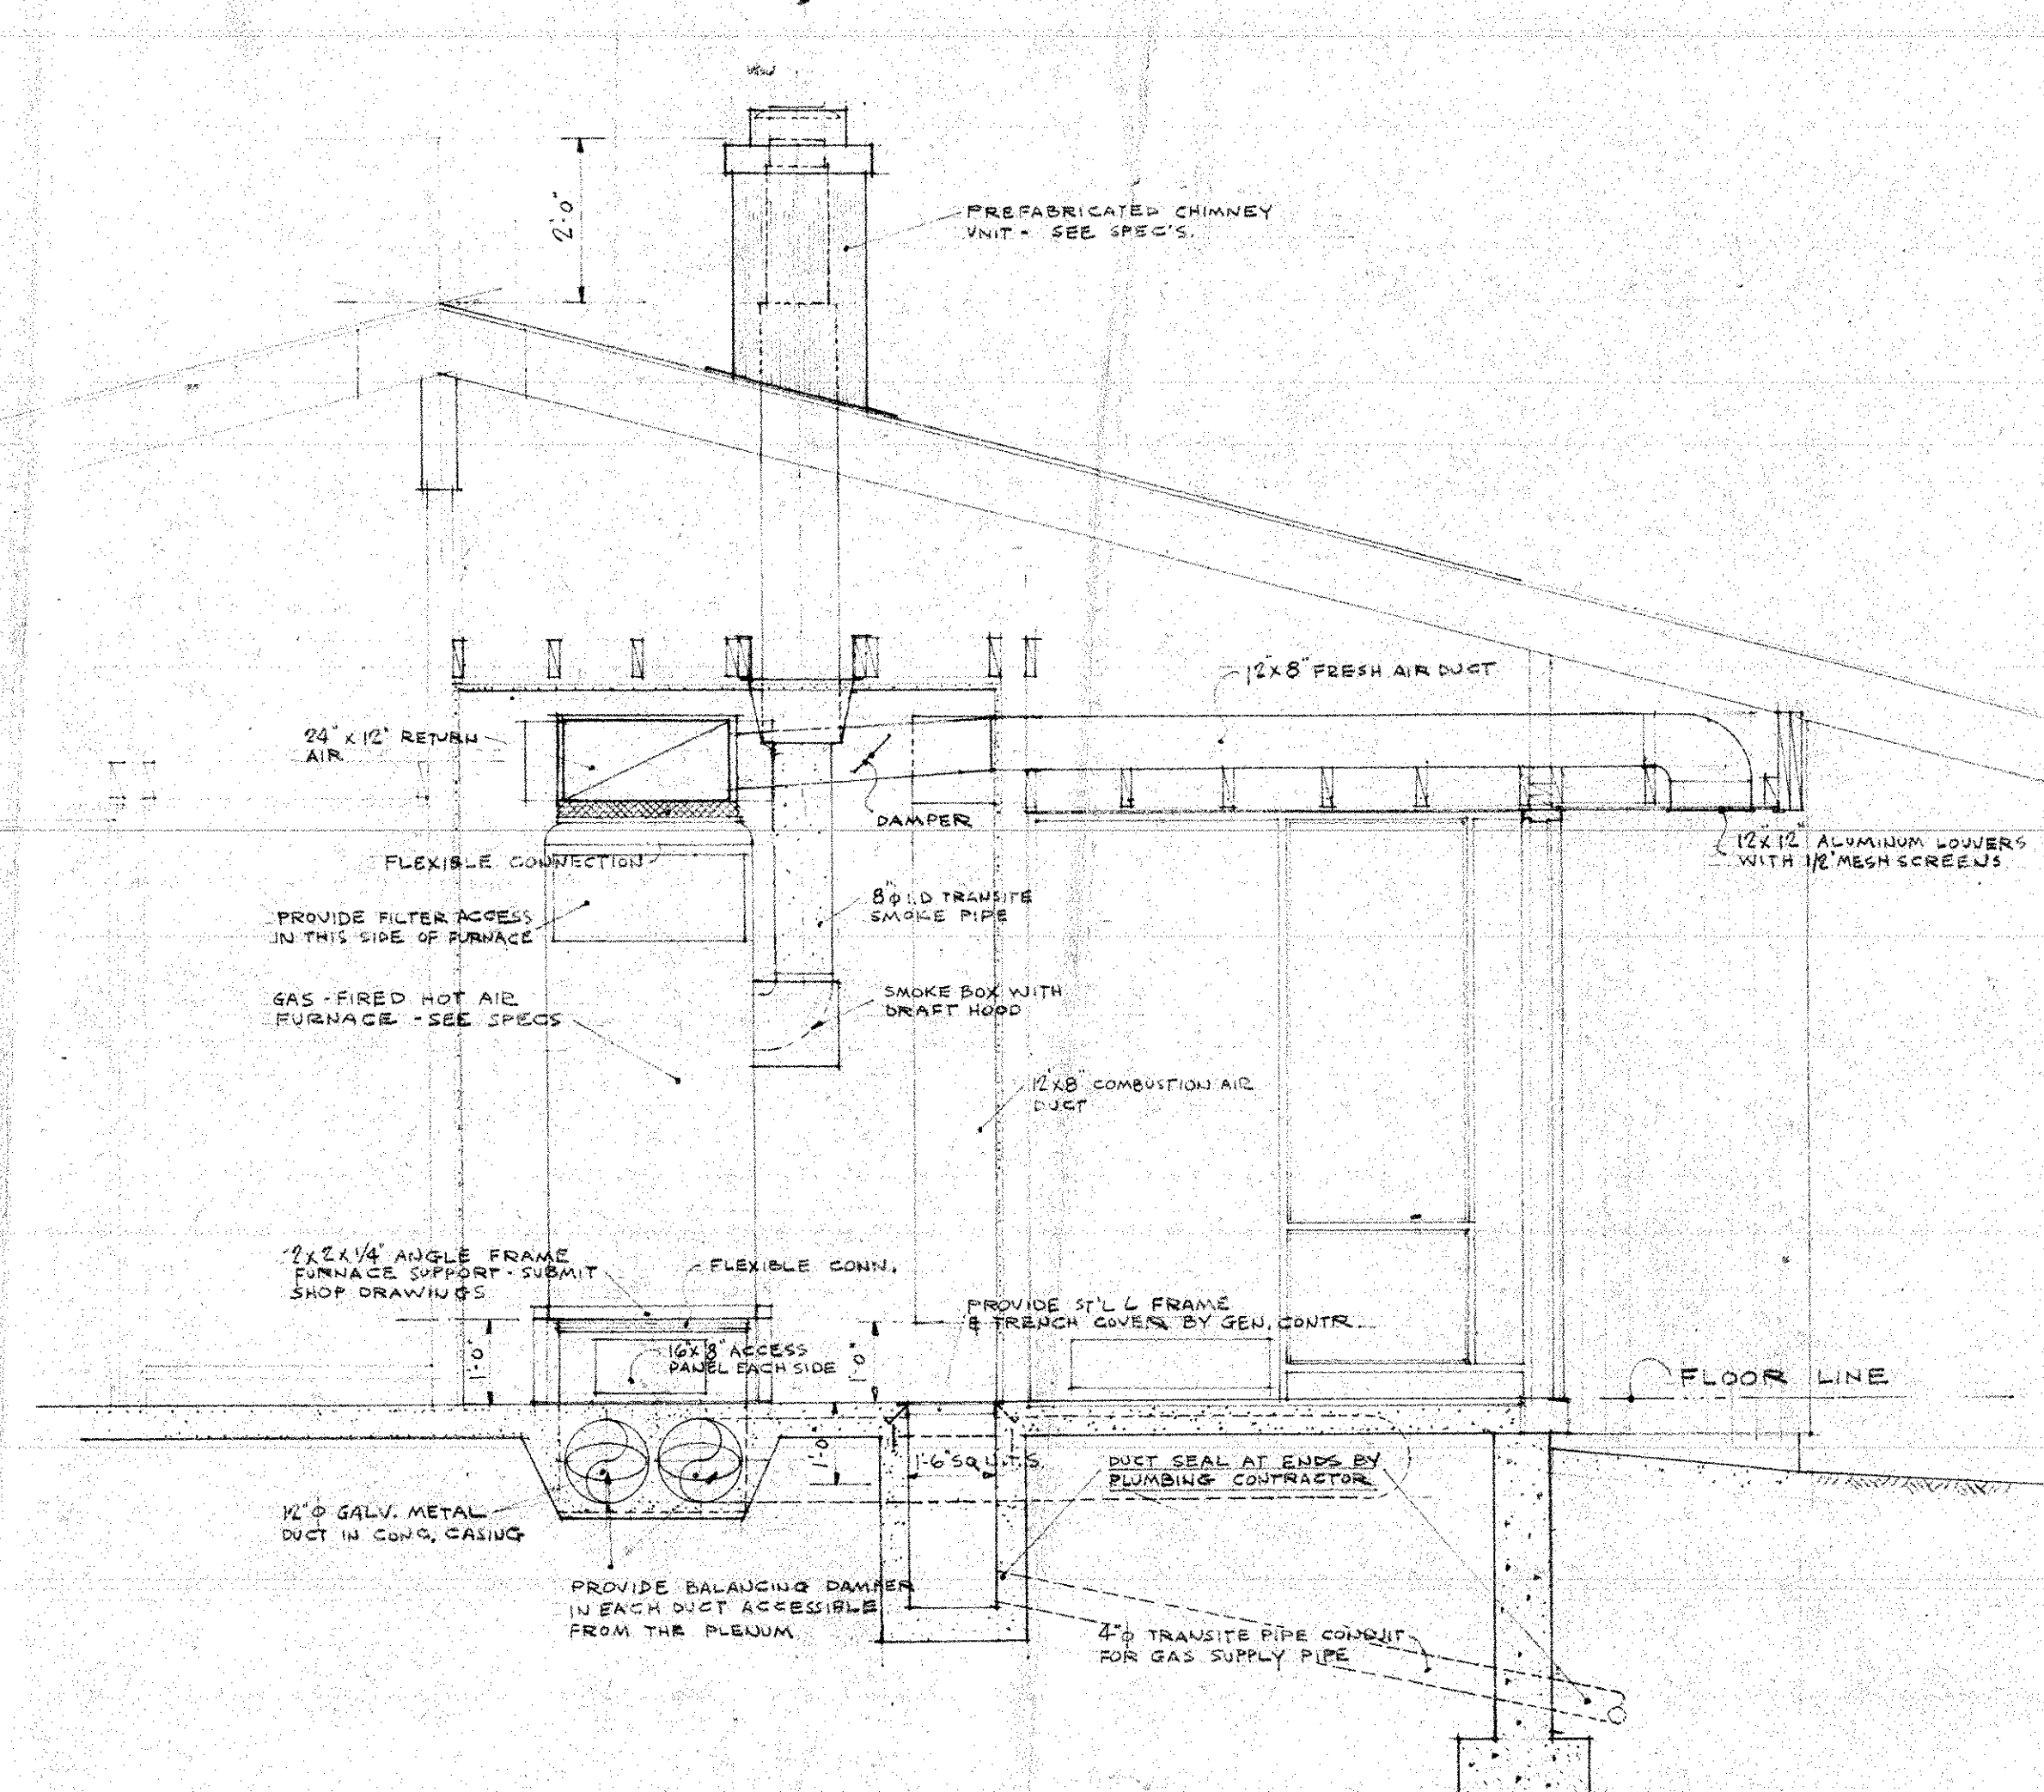

SECTION

SCALE: 1/2" = 1'-0"

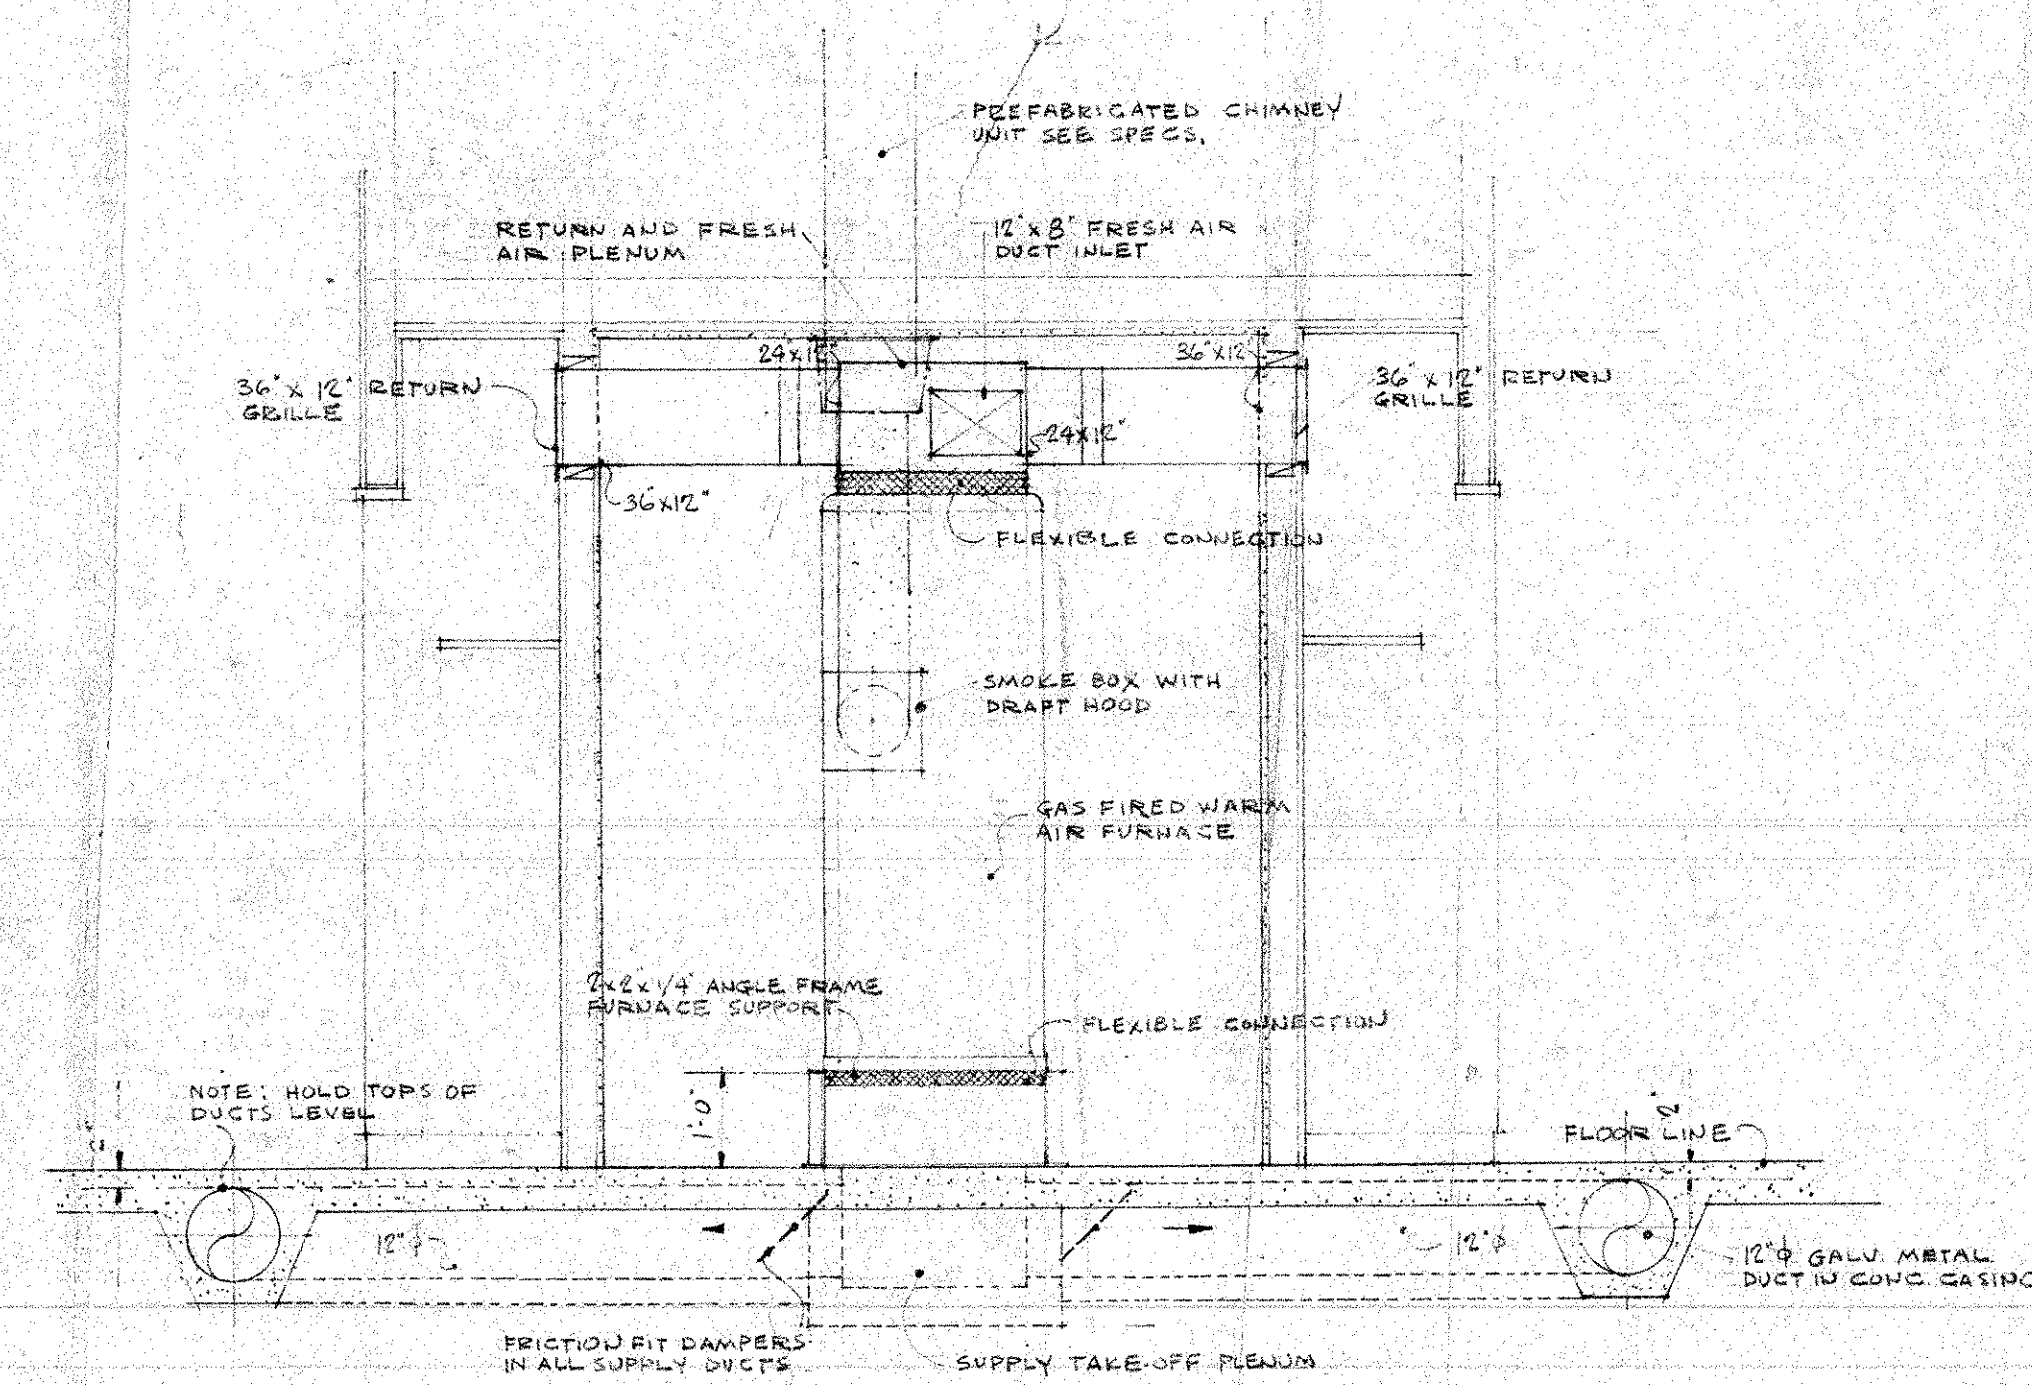

SECTION

SCALE: 1/2" = 1'-0"



FRED S. DUBIN ASSOCIATES
ENGINEERS
HARTFORD, CONNECTICUT
CAMBRIDGE, MASSACHUSETTS
COMMISSION NO. 1660 DATE

CULL, ROBINSON AND GREEN ARCHITECTS AND ENGINEERS 395 BENEFIT STREET - PROVIDENCE 3 RHODE ISLAND BASIL W. GILBERT, C.E. GASPEE 1-4927			
ELEMENTARY-JUNIOR HIGH SCHOOL FOR THE TOWN OF NORTH SMITHFIELD RHODE ISLAND			
DATE	DRAWN BY G.V.J.	CHECKED BY H.L.M.-K.D.R.	JOB NO. 1648
HEATING - BLDG'S #1-#2-#3-#4			SHEET NO. 20